

# HUMES

## API Oil Interceptor



## Design meets the standards set by the Oil Industry Guidelines and ARC TP10 (2003)\*

**The Humes API Oil Interceptor is designed to separate hydrocarbons from stormwater runoff and has the capability to capture an accidental spill up to 2500 litres discharging at 1000 litres per minute. The butterfly shut-off valve closes at capacity allowing containment of excessive accidental spills.**

### Applications

- Service stations
- Truck stops
- Vehicle service centres
- Terminals and depots
- Blending and manufacturing plants

### Benefits

- Cost effective
- Safe and reliable
- Reduced installation cost
- Retention of accidental spill
- Easy access for servicing

### Features

- Efficient separation, industry compliance
- Full range to suit individual catchment areas
- Emergency shut-off
- Few moving parts
- Quality precast unit
- Designed to carry legal wheel loadings



### Testing and Design

Testing and design of the Humes API Oil Interceptor has been carried out as per requirements of ARC TP10 (2003) and the Environmental Guidelines for Water Discharge from Petroleum Industry sites in New Zealand (MFE):

- to retain at least 2500 litres of spill
- to discharge less than 15 parts/million total petroleum hydrocarbons
- to not exceed 25m/hour horizontal velocity through unit.

\*TP10 is a design guideline manual for Stormwater Management Devices published by the Auckland Regional Council

# API Oil Interceptor

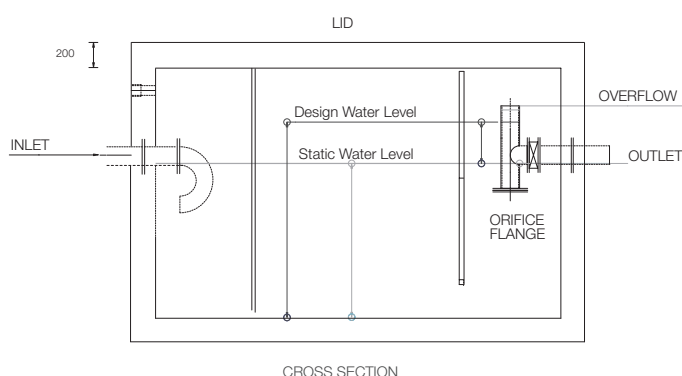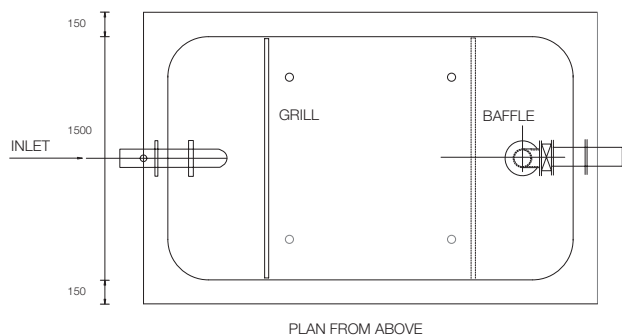

## Installation

The Humes API unit must be bedded to a level and uniform surface providing a safe bearing capacity of 100kPa. If for any reason this cannot be achieved an engineer experienced in foundations should be contacted for specialist advice.

The minimum requirement for the prepared bedding is a 100mm layer of compacted granular material. The lid must be bedded uniformly on all sides to a full width layer of mortar.

Units installed below ground or on a sloped finished ground or pavement surface must be designed specifically for those conditions. Wall props are required as tabulated below.

## Maintenance and operation

The units must be maintained and operated in accordance with the appropriate industry guidelines and the environmental management plan developed for the site.

## Manufacturing standards

All materials comply with the relevant New Zealand standard. Precast manufacture is to NZS 3109:1997 with surface finishes to NZS 3114:1987, F4 and U2 for formed and trowelled respectively. Concrete has a design strength of 40 MPa.

## API Oil Interceptor

### Oil Industry Guidelines

Model Reference	API3000	API3500	API4000	API4500	API5000	API5500
<b>Item Code (API Body fitted out)</b>	04070	04073	04022	04028	04043	04052
<b>Item Code (API lid c/w access covers)</b>	04098	04078	04024	04032	04050	04054
<b>Internal Length</b>	3000	3500	4000	4500	5000	5500
<b>Internal Width</b>	1500	1500	1500	1500	1500	1500
<b>External Height</b>	1850	1850	1875	1875	1875	1875
<b>External Length</b>	3300	3800	4300	4800	5300	5800
<b>External Width</b>	1800	1800	1800	1800	1800	1800
<b>Unit Weight (tonnes)</b>	10.6	11.9	13.9	15.4	16.6	18.0
<b>R.H.S. Struts</b>	1	1	1	2	2	3
<b>Intercepted Length to Baffle</b>	2400	2900	3400	3900	4400	4900
<b>Capacity for AGO (SG 0.9) m<sup>3</sup></b>	3.00	3.63	4.25	4.88	5.50	6.13
<b>Design Flow m<sup>3</sup>/hr</b>	2.45	2.95	3.45	3.95	4.35	4.80
<b>Orifice Size D mm</b>	25	28	30	32	33	35
<b>Catchment Area m<sup>2</sup></b>						
9mm/hr	272	328	383	439	483	533
12mm/hr	204	246	288	329	363	400
15mm/hr	163	197	230	263	290	320
<b>ARC Chapter 10, TP10</b>						
Design Flow m <sup>3</sup> /hr	1.75	2.10	2.40	2.75	3.05	3.40
Orifice Size D mm	21	23	25	27	28	30
Area m <sup>2</sup> 15mm/hr	117	140	160	183	203	227

