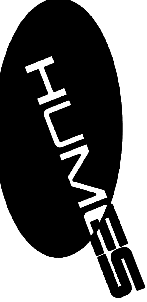


**NOTES:**

- 1 MANUFACTURE IN ACCORDANCE WITH NZS 3109:1997 ( PRECAST UNITS)
- 2 CONCRETE STRENGTH @ 28 DAYS 40MP<sub>a</sub>, MIN. STRIPPING STRENGTH 15MP<sub>a</sub>
- 3 REINFORCEMENT STEEL IN ACCORDANCE WITH NZS 3422 & NZS 3402  
HD BARS = 430MP<sub>a</sub> & MESH = 485MP<sub>a</sub>
- 4 SURFACE FINISHES TO NZS 3114:1987, FORMED SURFACE – F4 FINISH & TROWELLED SURFACE – U2 FINISH
- 5 ALL JOINTS TO BE EPOXIED
- 6 FOR LIFTING OF COMPLETE UNIT (EXCLUDING LID) A FOUR POINT EQUALESD SYSTEM USING THE 5T FA120 SWIFTLIFT ANCHORS ONLY SHOULD BE USED

 <p><b>Humes Pipeline Systems</b> Private Bag 82817 Auckland Freephone 0800 502 112 www.humes.co.nz</p>		Contractor		HUMES	
		PHONE		WWW.	
Rev	Description	Date	By	Chkd	Product
A	FOR APPROVAL FOR CONSTRUCTION	21-4-09	GB	WA	INSPEC. CHAMBER
B		22-4-09	GB	WA	DETAILS ON SHEET NO.
Project Name			Code		
TELCO 2700x1400x1400			04820		
FOOTWAY INSPECTION CHAMBER			Layout On SHEET NO.		
Dwg Title			Scales		
ELEVATIONS			NTS		
Date			Drawn		
Checked By			GB		
Date			WA		
Dwg. No.			04820-S1		
Rev.			B		

Copyright: This design, information and drawing remain the property of Humes Pipeline Systems and may not be used or copied without approval in writing from Humes Pipeline Systems.